


## Sc.7. Scurgeri majore (fisura d=5 cm) la rezervorul GPL skid\_FlashFire

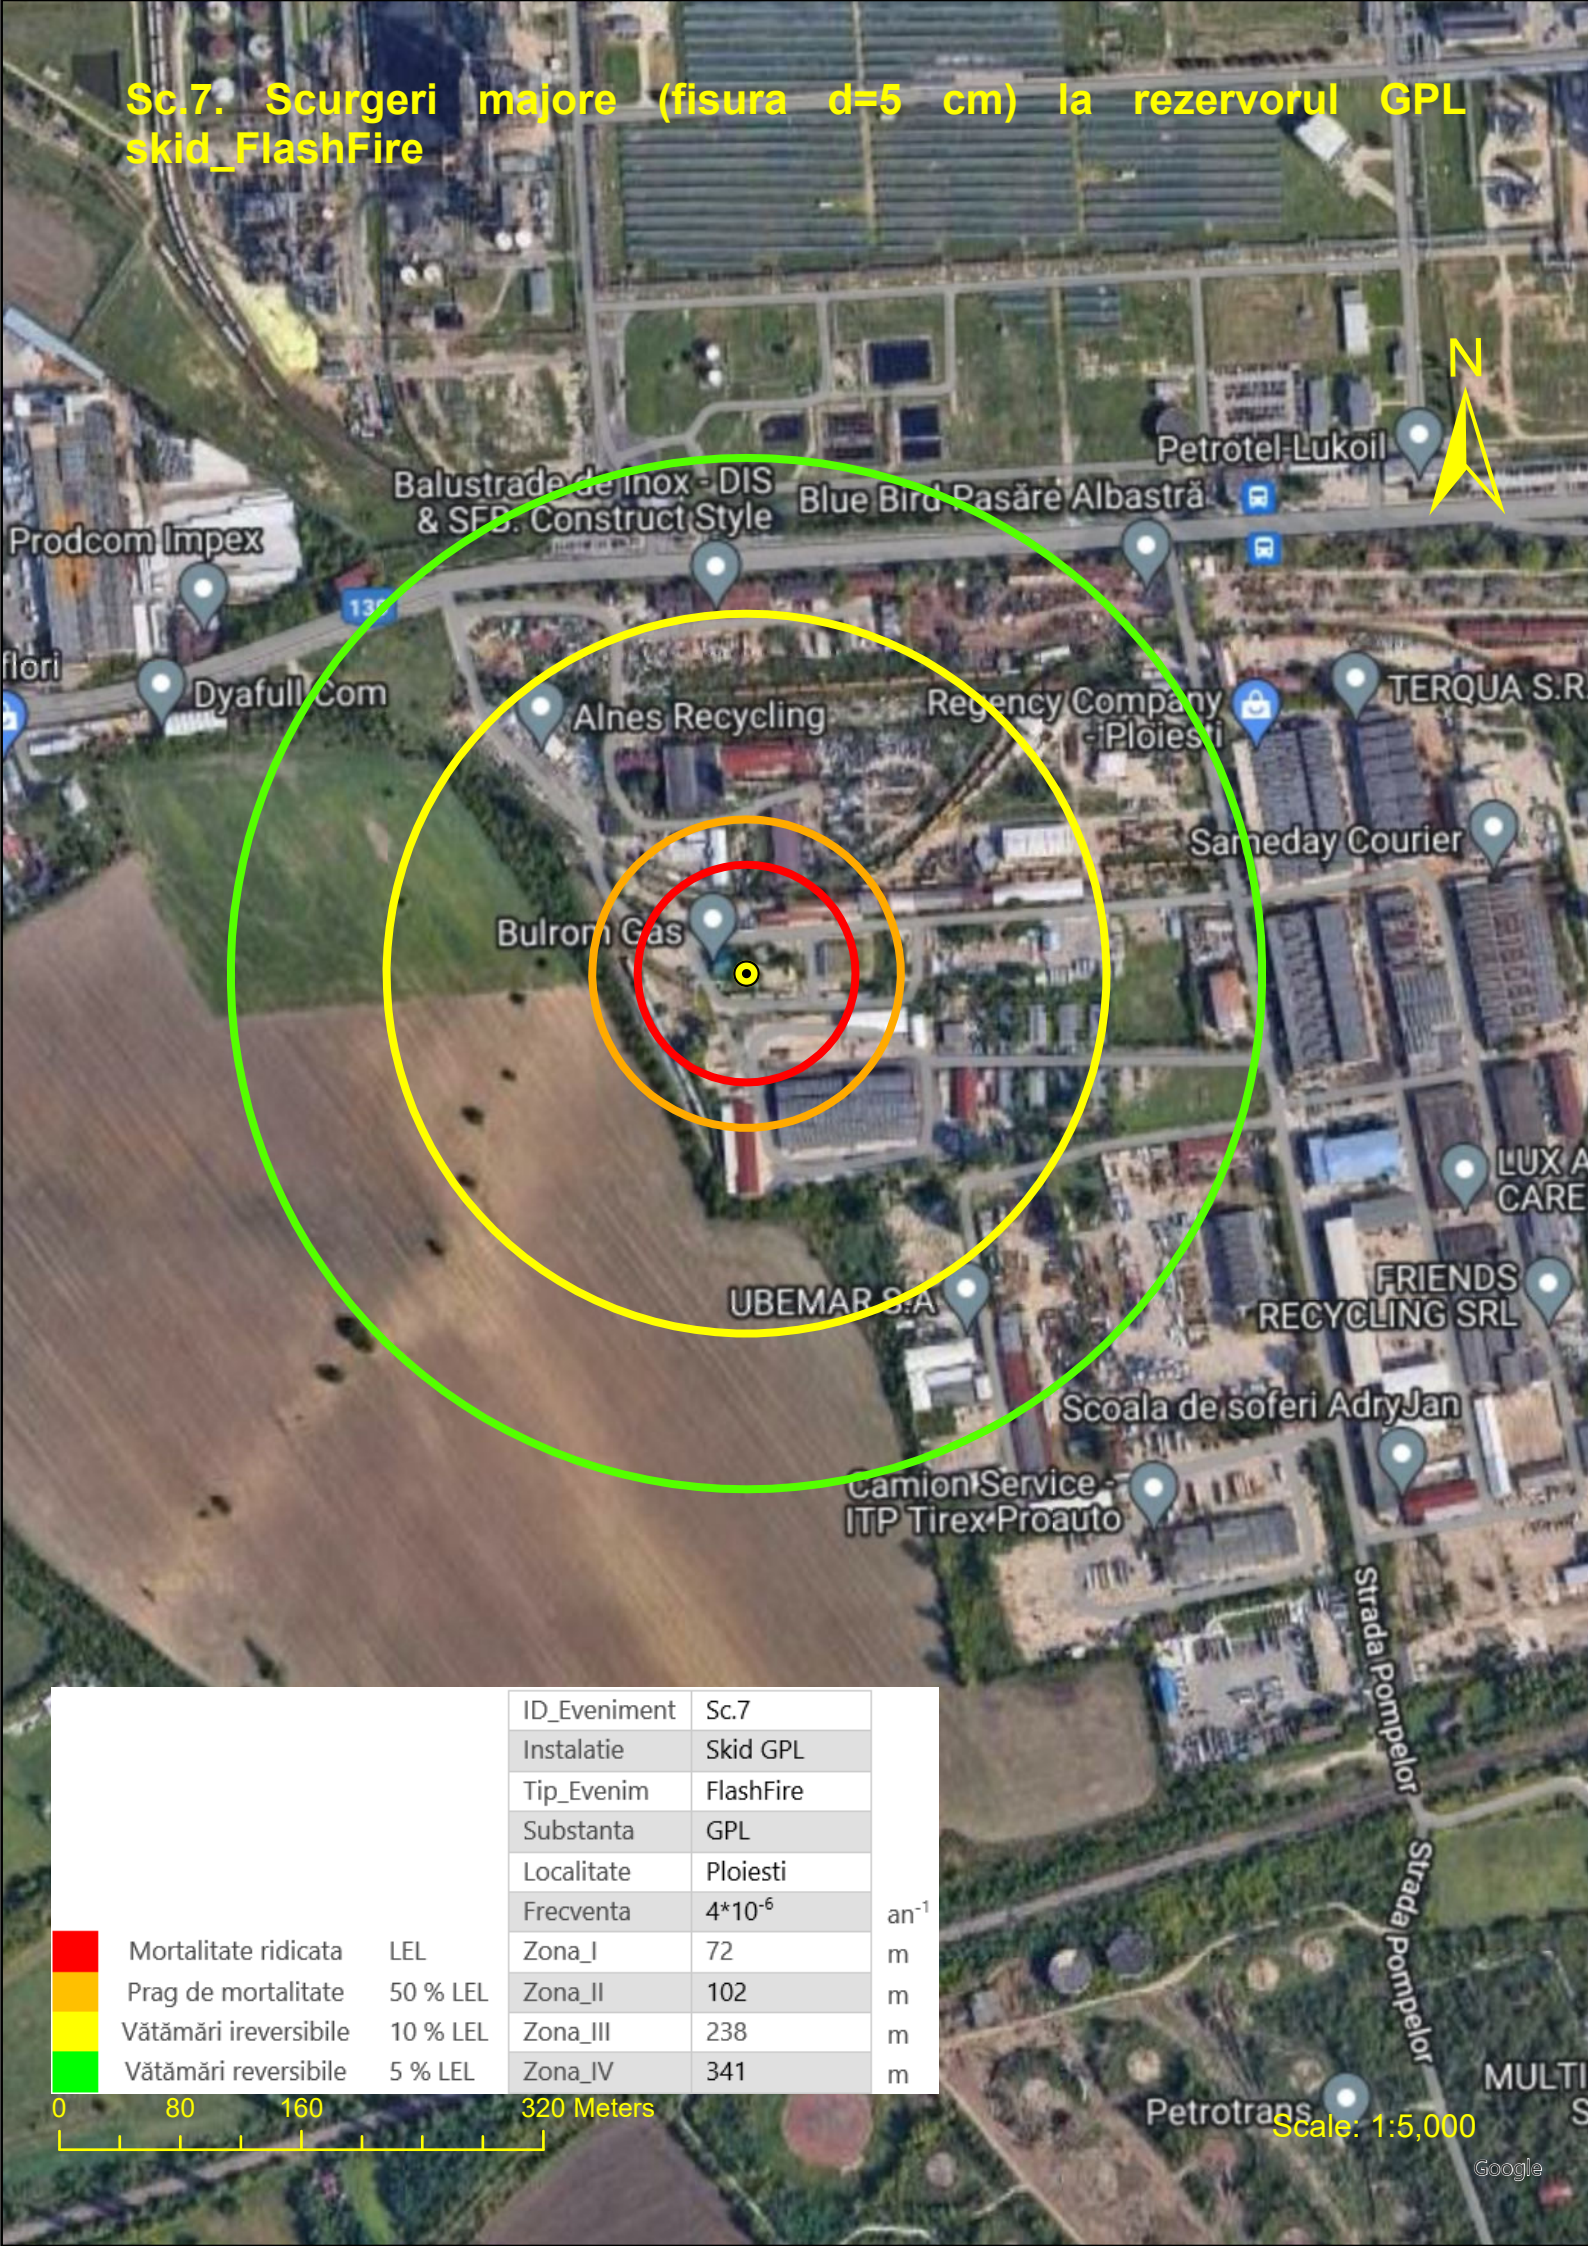

	ID_Eveniment	Sc.7	
	Instalatie	Skid GPL	
	Tip_Evenim	FlashFire	
	Substanta	GPL	
	Localitate	Ploiesti	
	Frecventa	$4 \cdot 10^{-6}$	an <sup>-1</sup>
<span style="color: red;">■</span>	Mortalitate ridicata	LEL	Zona_I
<span style="color: orange;">■</span>	Prag de mortalitate	50 % LEL	Zona_II
<span style="color: yellow;">■</span>	Vătămări ireversibile	10 % LEL	Zona_III
<span style="color: green;">■</span>	Vătămări reversibile	5 % LEL	Zona_IV
			72
			102
			238
			341
			m
			m
			m
			m

0 80 160 320 Meters

Scale: 1:5,000